





## Specifications:

**Height:** 21.32" (54.15 cm)  
**Width:** 21.44" (54.47 cm) with Bracket  
**Depth:** 11.7" (29.7 cm) with Bracket  
**Weight:** 52.0 lbs (24.0 kg)  
**Ports:** 3/4"-14 NPT  
**Service Clearance (Top):** 10.0" (25.4 cm)  
**Vacuum Installation Recommended**  
**Maximum Pressure:** 15 psi (1.03 bar)  
**Max Flow Rate:** 540 gph (2044 lph)

FH Model Superseded to FV Model.  
 See RSL0428 FH-FV Change Notification  
 for available assemblies crosses.

**RACOR®**

## Dimensions:

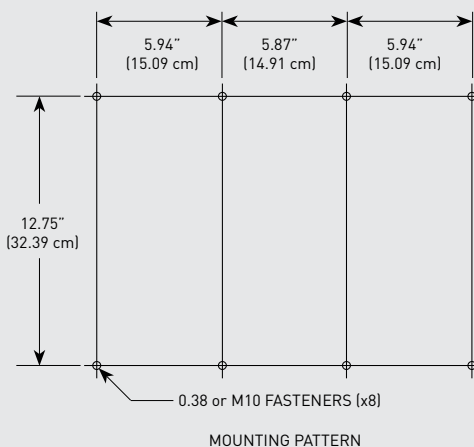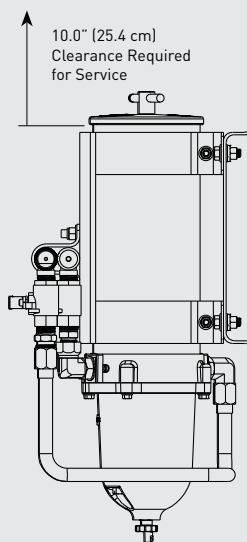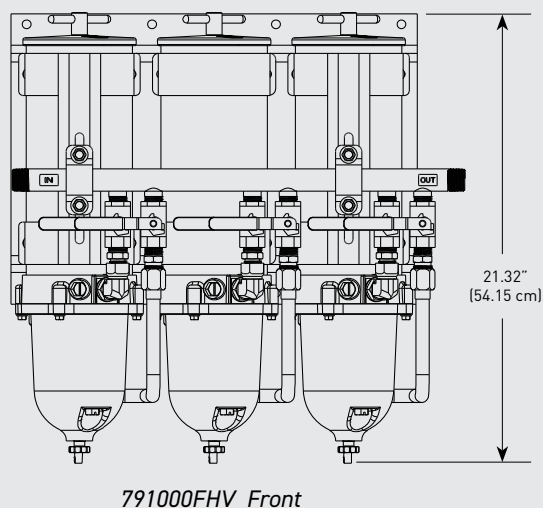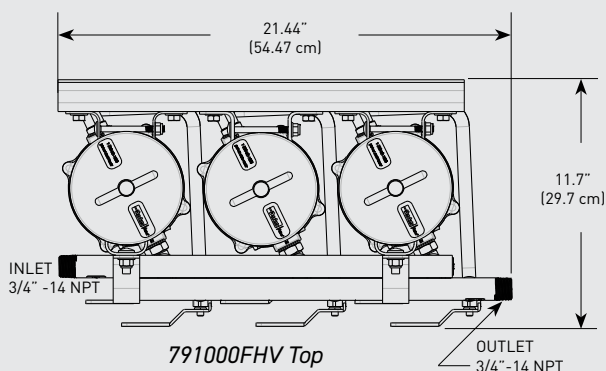


TRIPLE ASSEMBLIES

# PARTS

## Turbine Series - 791000FHV


1



1A

1B

2



2A

2B

3



3A

4




4A

5



5A

6

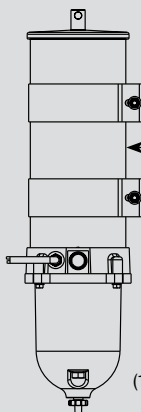

6A

See **RSL0292**  
For 1000FH Parts Breakdown

Part #	Description
1A	Mounting Bracket - <i>Contact Technical Support</i>
1B	Manifold Assembly Bracket - <i>Contact Technical Support</i>
2A	19460 Inlet Manifold Tube (3/4"-14 NPT) - (Tan)
2B	19461 Outlet Manifold Tube (3/4"-14 NPT) - (Tan)
3A	RK 11073 Ball Valve Assembly (uses 6)
4A	Manifold tube - <i>Contact Technical Support</i>
5A	U-bracket (uses 2)
6A	Turbine Fuel Filter - 1000FH Series (Uses 3) See Cutsheet <b>RSL0292</b> for available Parts and Accessories

### Accessories and Parts Available (Not Shown)

7A	RK 11-1952	Complete Seal Service Kit - 1000FH Series Filters (Requires 3)
	RK 11-1404	Complete Seal Service Kit - 1000 Series Filters For FG and Older Models (Requires 3)
7B	RK30880E	WIF Sensor and Light Kit - 1/2"-20 UNF *
	RK33802	WIF Probe Kit - 1/2"-20 UNF - Two Wire Pigtail * Water Detection Module Required - <b>Use 7C</b>
7C	RK 14329	Water Detection Module - 12 vdc
	RK 14321	Water Detection Module - 24 vdc
8A		Bowl Gasket - <b>Included in 7A</b>
8B	RK 11-1938	Bowl Kit - <b>Includes 8A, 8C &amp; 8D</b>
8C	RK 20126	Bowl Plug ( <b>O-ring Included in 7A</b> )
8D		Self-venting Drain ( <b>O-ring Included in 7A</b> )
9A	2020V2 2020V10 2020V30	1000FH Replacement Element 2 micron (uses 3) 1000FH Replacement Element 10 micron (uses 3) 1000FH Replacement Element 30 micron (uses 3)

\* Note: If all 3 units are used simultaneously, one probe or sensor can be used. If units are used as backups, then a probe or sensor should be installed in each bowl. Multiple probes can be wired in parallel to a single detection module.



Online Link  
Turbine Series Selector



Online Link  
Turbine Series  
Replacement Parts Selector